




# AFT POTABLE WATER TANK - FILLING



TANK IN PLACE

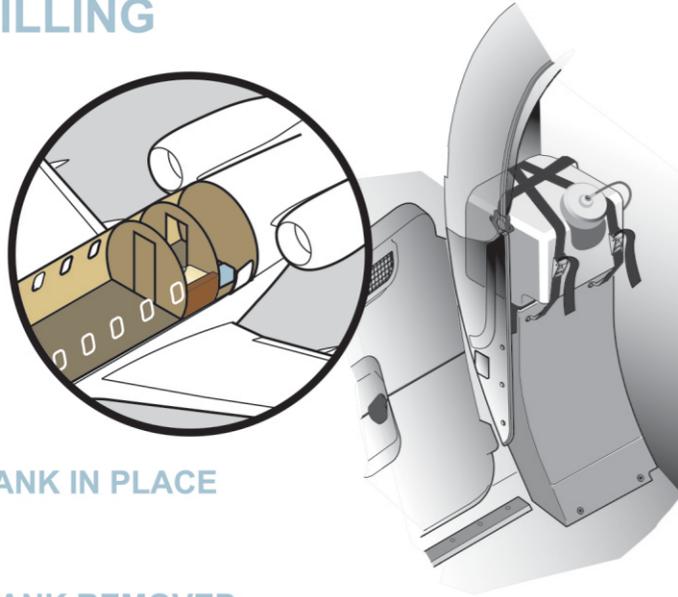

TANK REMOVED

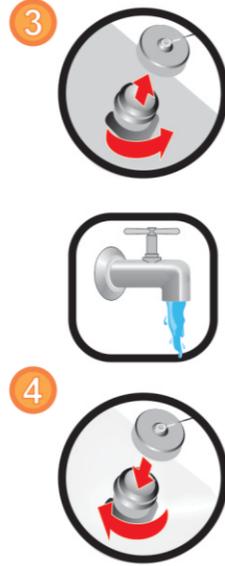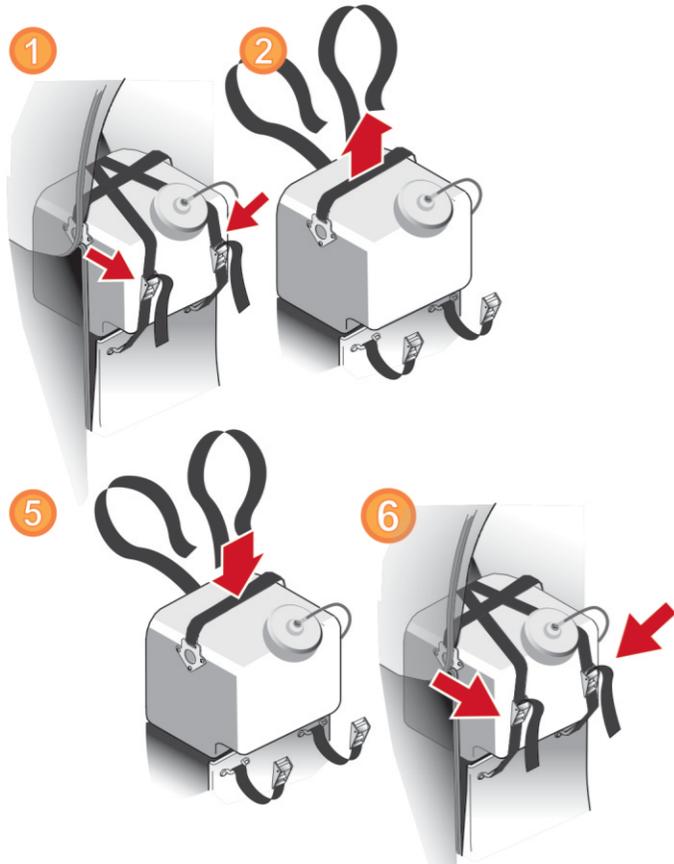

0°C (32°F) or lower

**MINIMUM**



**20 minutes**

# WATER SERVICING GUIDE





This guide is intended only to assist ground personnel. Always follow the applicable instructions in the Supplemental Maintenance Manual (SMM) and obey all safety precautions when performing potable water servicing procedures. In the event of a conflict between the instructions in this guide and the SMM, the SMM shall take precedence over this guide.

## AFT POTABLE WATER TANK - DRAINING

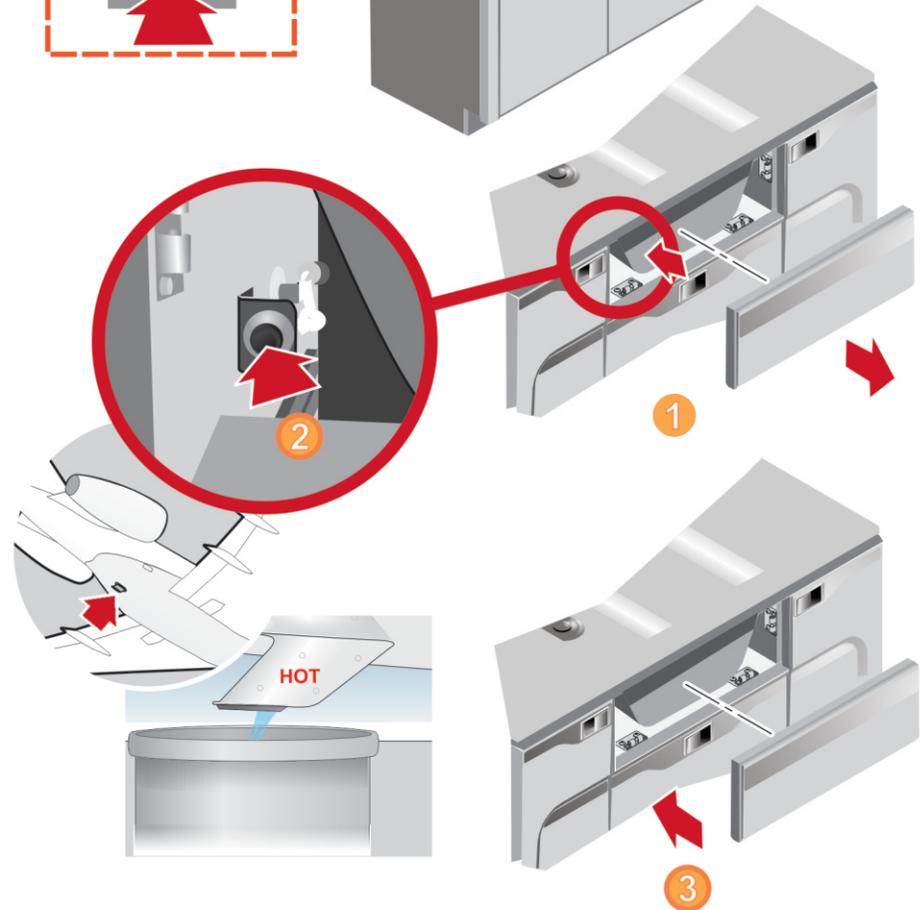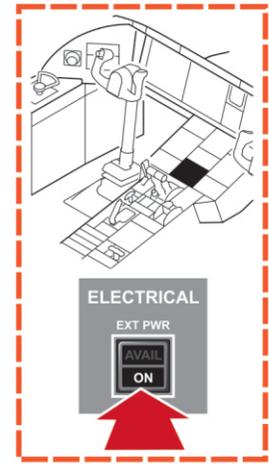

## GALLEY with SINK (IF INSTALLED) DRAINING

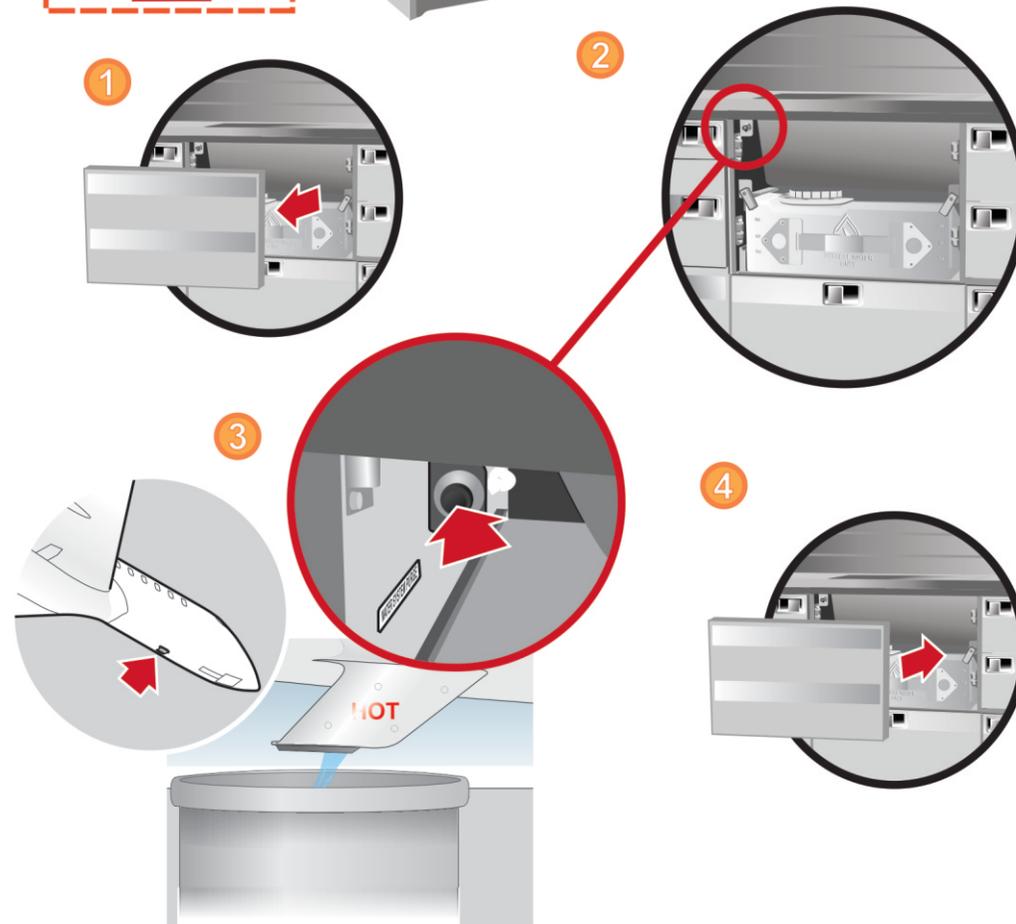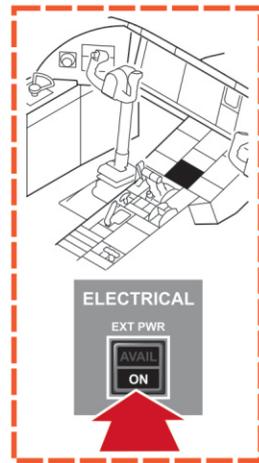

## FILLING

